


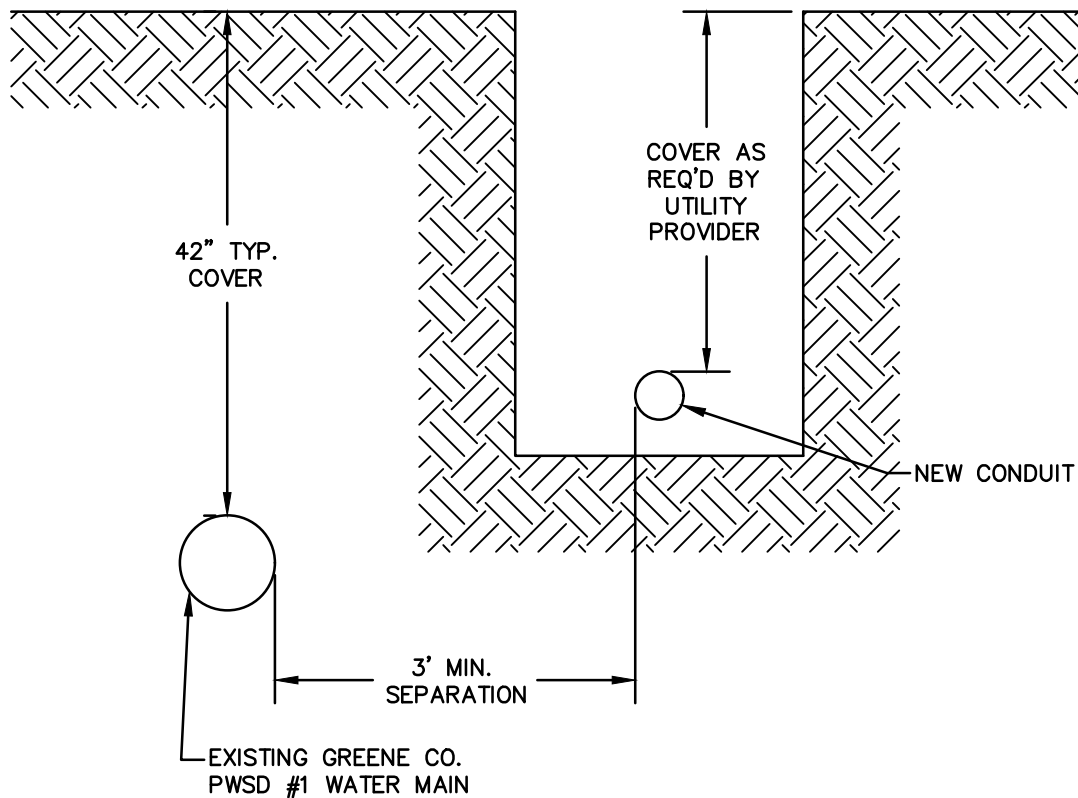

NOTES:

1. UTILITY CONTRACTOR SHALL PROVIDE GREENE CO. PWSD #1 STAFF 48 HOURS NOTICE PRIOR TO INSTALLATION OF CONDUIT ADJACENT TO DISTRICT WATER MAIN.
2. PROVIDE PRE-INSTALLATION MEETINGS TO ALL PARTIES ON MAJOR INSTALLATIONS.
3. DESIGNATE A POINT OF CONTACT WHO SHALL BE AVAILABLE 24 HOURS PER DAY, 7 DAYS PER WEEK WHILE THE PERMITTEE IS PRESENT IN AREAS OF DISTRICT WATER MAIN.
4. INCLUDE THE NAME AND TELEPHONE NUMBERS OF THE UTILITY COMPANY/GENERAL CONTRACTOR.

UTILITY INSTALLATION ADJACENT
TO WATER MAINS

NO SCALE